

BARRIER PRODUCER STATEMENT PS1

Pool Fencing and Fall Restraint Barriers
(Engineering Specifications and Installation Details
for Compliance with NZBC B1, F4, F9)



Barrier specification selection guide

Clause F4 'Safety from Falling' of the New Zealand Building Code requires building areas to be constructed to reduce the likelihood of accidental falls. Specifically, barriers are required where people could fall one metre or more.

Barriers need to be designed and constructed so that they are capable of providing the strength and stiffness necessary for the proposed location and occupancy type of the property which they serve. Evidence of the suitability of the barrier system for its proposed

use, needs to be provided when making a building consent application. This producer statement provides the assurance that Fentec product specifications and installation details have been pre-approved by Chartered Professional Engineers and comply with all NZBC B1, F4, F9 requirements.

It is important that your selected barrier design is appropriate to the specific installation location and intended use. Use this guide to determine your specific barrier design and installation details.

Generic Producer Statement

This is a generic Producer Statement, issued to Terranota Ltd, which provides the assurance that the proprietary products detailed in this document have been structurally engineered to comply with the New Zealand Building Code and the building code clauses as detailed, and for the application(s) as described in this document.

The fencing components detailed in this Producer Statement are proprietary products, engineered to comply with the requirements of the stated building code clause. Of equal importance is the detail of the fixing method to ensure the correct installation of the proprietary components. To this end, most common installation applications have been illustrated with appropriate details to ensure a safe and compliant fence/balustrade.

The structure (or ground conditions) to which the proprietary components are installed is the responsibility

of the installer or end user, and it is recommended that an independent engineer is engaged to confirm the compliance of the structure (or ground condition) with the New Zealand Building Code. Where relevant, and when critical to the compliance of the proprietary components, this producer statement details specific requirements of the structure (or ground conditions) as a minimum standard.

It is the installer or end user's responsibility to ensure the proprietary components are installed accurately to the detail provided. If your particular structure design or application is not covered in the details provided, then this generic producer statement cannot be applied to your installation. In this instance, please contact Fentec to discuss a custom-engineered solution that will meet your requirements.

Barrier Loading Selection

Where a barrier serves multiple occupancies, default to the highest loading requirement from all location scenarios. For more information, please refer to www.building.govt.nz

Occupancy type	Building code clause	Specific use	Horizontal design loading	Minimum overall barrier height
A - Domestic	Pool fence only	0.33kN/m	1.2m	All fixing details are applicable
A - Domestic	All areas serving one dwelling but excluding balconies, decks & terraces, e.g., walkways, stairs & landings, & retaining walls not adjacent to a deck or terrace	0.35kN/m	1.0m 0.9m for stairs only	DPA653501 DPA653502 DPA653503
A - Domestic	External balcony, decks, terraces, retaining walls & walkways in a multi-dwelling application, including open public spaces	0.75kN/m	1.0m single dwelling 1.1m multi dwelling	DPA667501 DPA667502 DPA667503 DPA667504
B & E - Offices & work areas including storage	Access walkways, stairs & landings	0.35kN/m	1.1m	DPA653501 DPA653502 DPA653503
B & E - Offices & work areas including storage	Areas including balconies, decks & terraces not susceptible to overcrowding	0.75kN/m	1.1m	DPA667501 DPA667502 DPA667503 DPA667504
C - Areas without obstacles for moving people & where people might congregate	Areas including walkways, stairs & landings, balconies, decks & terraces not susceptible to overcrowding, including parks and reserves	0.75kN/m	1.1m	DPA667501 DPA667502 DPA667503 DPA667504

Post Fixing Details


The following pages detail common and standardised methods for fixing the barrier to various structures. First determine the barrier loading using the table above and reference the correct drawing(s) for that particular design. If a variant to these standard installation methods is required, please contact Fentec for further information about custom design and engineering services

Fixing types

There are four corrosion zones in New Zealand that relate to the severity of exposure to wind-driven salt. To determine the corrosion zone for your installation location, please check maps in Figure 4.2 in NZS3604:201 (or online search 'BRANZ Maps'). Use the table below to determine the appropriate fixing types required for your particular location.

Zone	Risk level & location	Fixing type
Zone B	Low risk	Hot dip galvinised
Zone C	Medium risk	Hot dip galvinised
Zone D	High risk, all offshore locations within 500m of coastline, including harbours, locations within 100m of tidal estuaries & sheltered inlets	316 stainless steel
Zone E	Very high risk, locations described in Zone D, beachfronts & seaside locations	316 stainless steel

Table 2 - Fixing Types

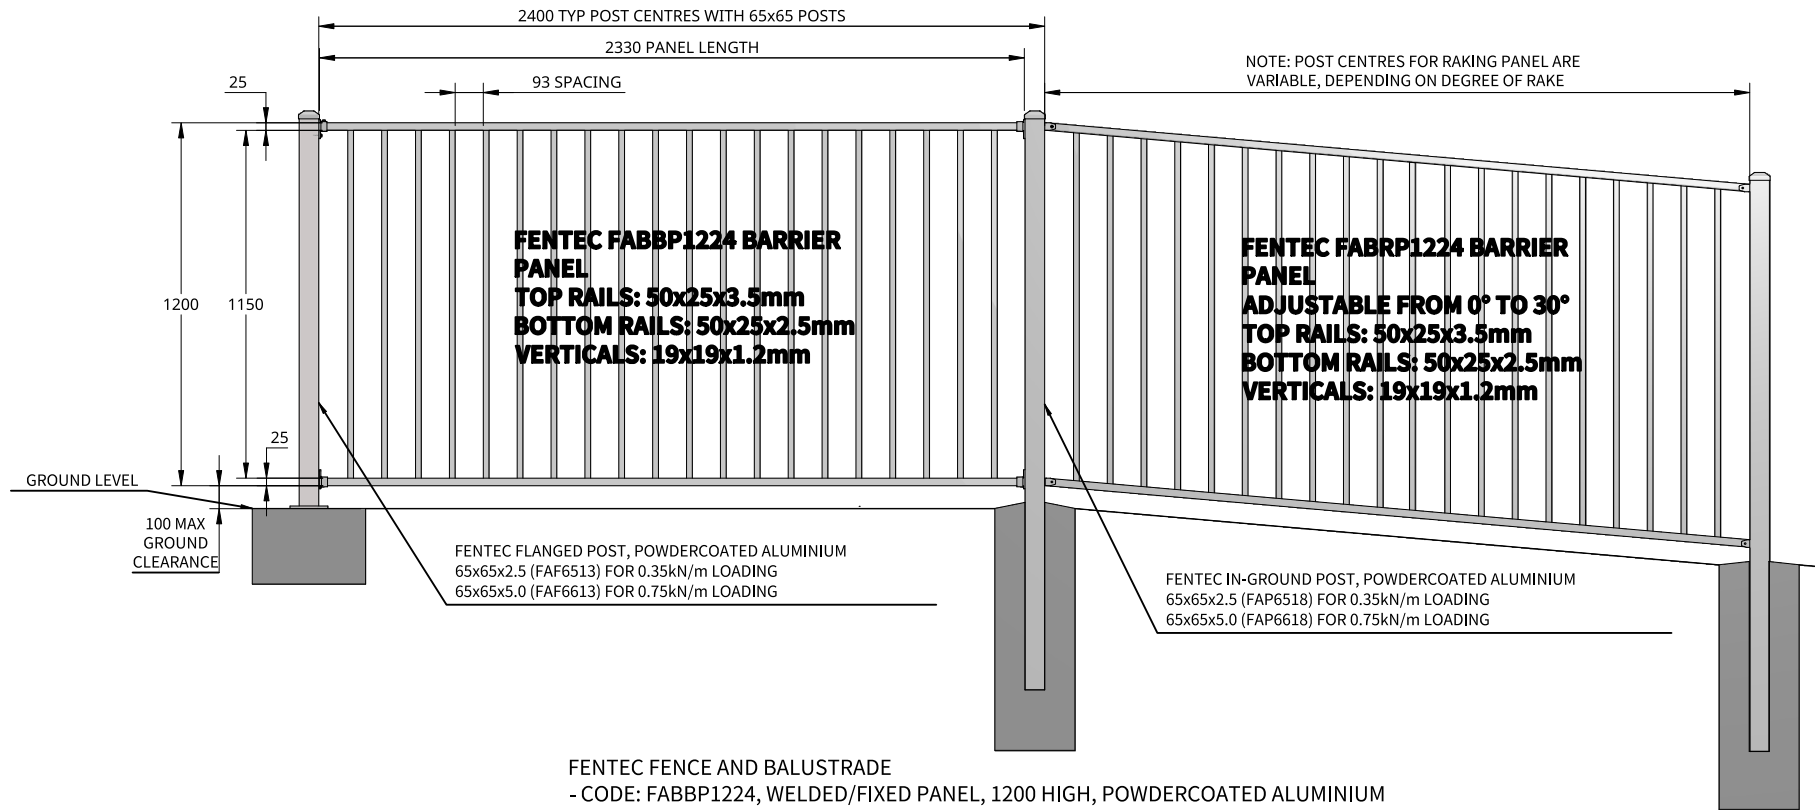

FENTEC FENCE AND BALUSTRADE
 - CODE: FABBP1224, WELDED/FIXED PANEL, 1200 HIGH, POWDERCOATED ALUMINIUM
 - CODE: FABRP1224, ADJUSTABLE/RAKING PANEL, 1200 HIGH, POWDERCOATED ALUMINIUM

General Notes

- All dimensions are in millimetres.
- Drawings are not necessarily to scale
- Check www.fentec.co.nz to ensure you have the most recent edition of this publication.

Fixing Notes

- All coach screws and bolts to be pre-drilled according to NZS 3603:1997
- When fixing self-drilling screws, ensure low torque setting to avoid thread stripping. A battery drill is recommended for self-drilling screws - DO NOT use an impact driver.

Corrosion Zones

There are four corrosion zones in New Zealand that relate to the severity of exposure to wind-driven salt. See maps in figure 4.2 of NZS 3604:2011 (or online search 'BRANZ Maps') to determine the corrosion zone of the installation location and appropriate fixing option required.

Zone	Risk Level & Location	Fixing Type
Zone B	Low risk	Hot-dip Galvanised
Zone C	Medium risk	Hot-dip Galvanised
Zone D	High risk, all offshore islands, locations within 500m of coastline including harbours, locations within 100m of tidal estuaries and sheltered inlets.	316 Stainless Steel
Zone E	Very high risk, locations described in Zone D, beachfronts and seaside locations.	316 Stainless Steel

Existing Support Structure

- Supporting structures as not covered by these drawings unless specific requirements are detailed.
- Supporting structures are by others and must comply with the New Zealand Building Code.
- If unsure of existing structure compliance, seek professional advice.




Terranota Ltd. P.O. Box 1703 Invercargill 1703
 Telephone: 0800 002 725
 Email: sales@fentec.co.nz
 Website: www.fentec.co.nz

©Copyright February 2024. All rights reserved to Terranota Ltd.


This document and the copyright in this document remain the property of TERRANOTA LTD. The contents of this document may not be reproduced either in whole or in part by any means whatsoever without the prior written consent of TERRANOTA LTD.

TITLE
**FENTEC BARRIER
 CODE: FABBP1224
 AND FABRP1224
 1200 HIGH**

SCALE	SIZE	DRAWING NO
1:25	A4	FAB1224
REV.	DATE ISSUED	SHEET
A	2024-02-26	3

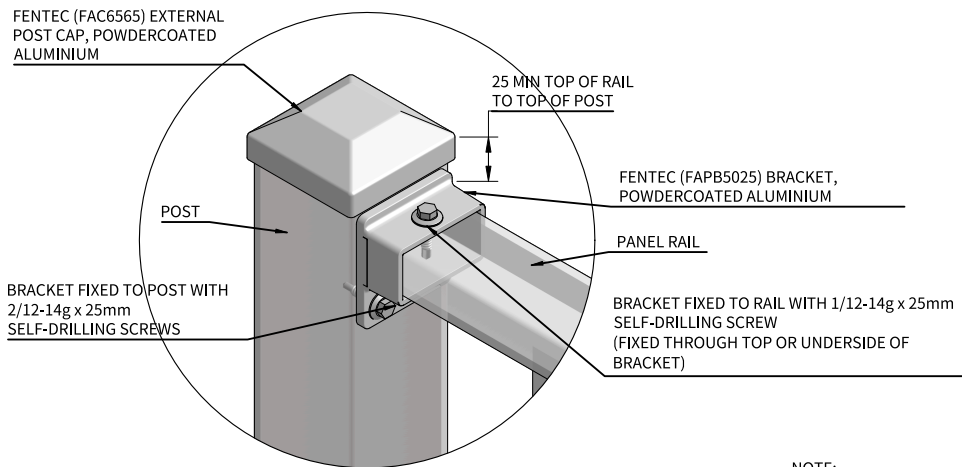


STANDARD PANEL BRACKET FIXING DETAIL
 SCALE: 1:3.5

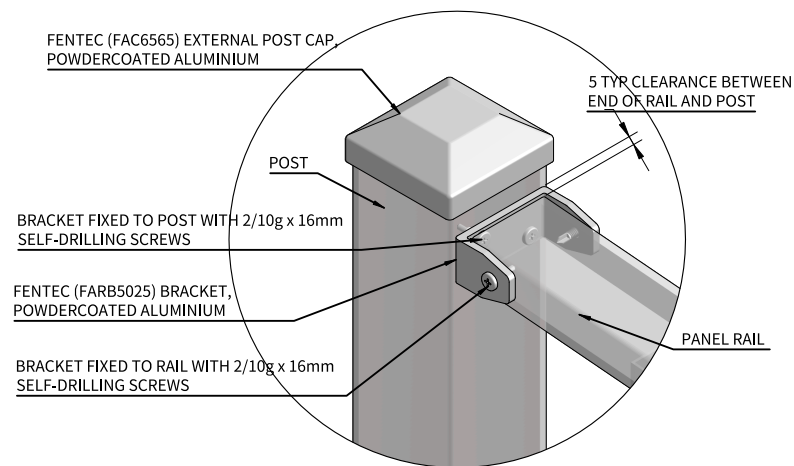


ADJUSTABLE PANEL BRACKET FIXING DETAIL
 SCALE: 1:3.5


NOTE:
 WHEN FIXING SCREWS USE LOW TORQUE SETTING ON DRILL TO ENSURE THREAD IS NOT STRIPPED. USE EXTRA CAUTION WHEN FIXING INTO ALUMINIUM. DO NOT USE AN IMPACT DRIVER AS THIS WILL VOID FENTEC WARRANTY

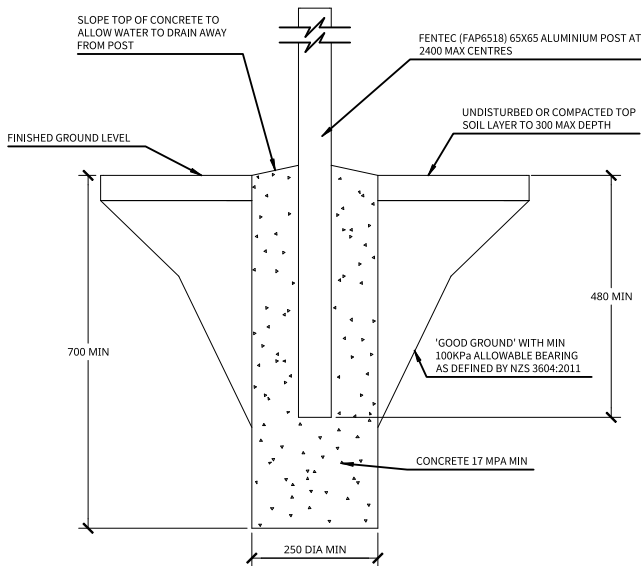

DRAWING NO: ICA653524
 APPLICATION: CONCRETE IN-GROUND
 LOADING: 0.35kN/m AT MAX 2400 POST CENTRES

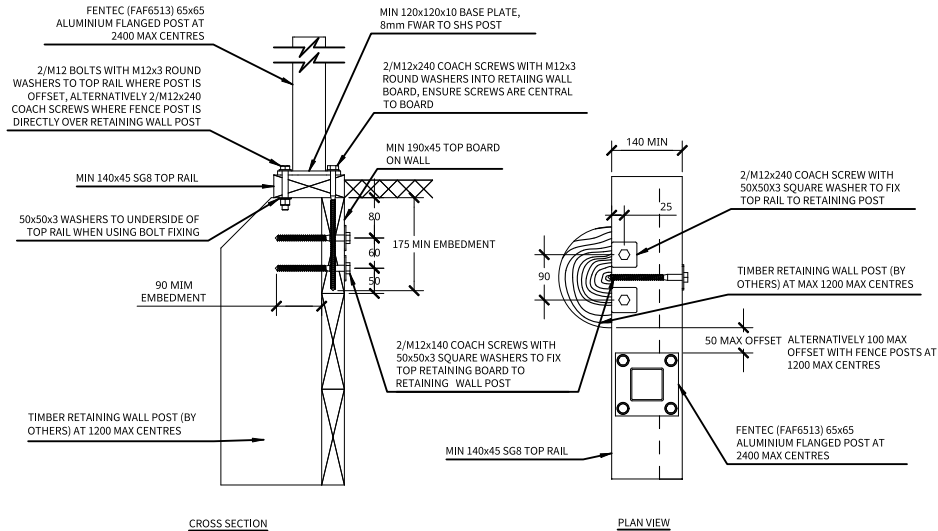


DRAWING NO: TRA653524
 APPLICATION: TOP-FIX TO TIMBER RETAINING WALL
 LOADING: 0.35kN/m AT MAX 2400 POST CENTRES

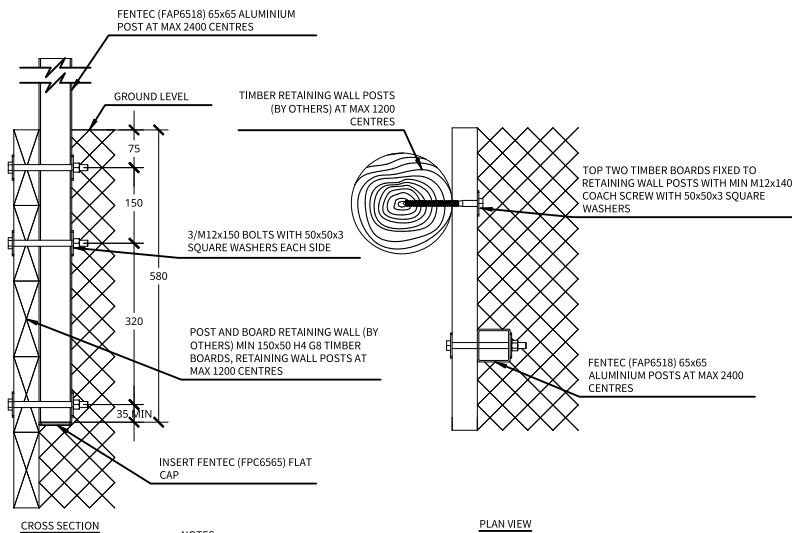

NOTES:
 IF WALL IS SLOPING, PACK FENCE POSTS TO VERTICAL AND ADJUST BOLT LENGTH TO SUIT.
 ALL INGROUND FIXINGS TO BE STAINLESS STEEL OR GALVANISED WITH DPM PROTECTION

DRAWING NO: SRA653524-A
 APPLICATION: SIDE-FIX TO TIMBER RETAINING WALL (POST ON INSIDE OF RETAINING WALL)
 LOADING: 0.35kN/m AT MAX 2400 POST CENTRES

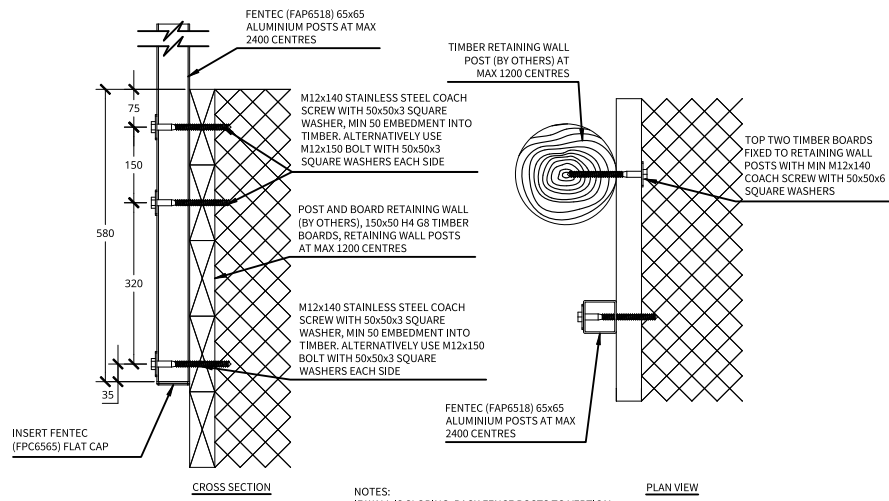

NOTES:
 IF WALL IS SLOPING, PACK FENCE POSTS TO VERTICAL AND ADJUST COACH SCREW LENGTH TO SUIT, ALL INGROUND FIXINGS TO BE STAINLESS STEEL

DRAWING NO: SRA653524-B
 APPLICATION: SIDE-FIX TO TIMBER RETAINING WALL (POST ON OUTSIDE OF RETAINING WALL)
 LOADING: 0.35kN/m AT MAX 2400 POST CENTRES

General Notes

1. All dimensions are in millimetres.
2. Drawings are not necessarily to scale
3. Check www.fentec.co.nz to ensure you have the most recent edition of this publication.

Fixing Notes

1. All coach screws and bolts to be pre-drilled according to NZS 3603:1997
2. When fixing self-drilling screws, ensure low torque setting to avoid thread stripping. A battery drill is recommended for self-drilling screws - DO NOT use an impact driver.

Corrosion Zones

There are four corrosion zones in New Zealand that relate to the severity of exposure to wind-driven salt. See maps in figure 4.2 of NZS 3604:2011 (or online search 'BRANZ Maps') to determine the corrosion zone of the installation location and appropriate fixing option required.

Zone	Risk Level & Location	Fixing Type
Zone B	Low risk	Hot-dip Galvanised
Zone C	Medium risk	Hot-dip Galvanised
Zone D	High risk, all offshore islands, locations within 500m of coastline including harbours, locations within 100m of tidal estuaries and sheltered inlets.	316 Stainless Steel
Zone E	Very high risk, locations described in Zone D, beachfronts and seaside locations.	316 Stainless Steel

Existing Support Structure

1. Supporting structures as not covered by these drawings unless specific requirements are detailed.
2. Supporting structures are by others and must comply with the New Zealand Building Code.
3. If unsure of existing structure compliance, seek professional advice.



Terranota Ltd. P.O. Box 1703 Invercargill 1703
 Telephone: 0800 002 725
 Email: sales@fentec.co.nz
 Website: www.fentec.co.nz

©Copyright February 2024. All rights reserved to Terranota Ltd.

This document and the copyright in this document remain the property of TERRANOTA LTD. The contents of this document may not be reproduced either in whole or in part by any means whatsoever without the prior written consent of TERRANOTA LTD.


TITLE
 FENTEC BARRIER FIXING DESIGNS
 FOR:

- CONCRETE IN-GROUND
- TIMBER RETAINING WALL

FOR 0.35kN/m HORIZONTAL LOADING


(REFER TO BARRIER SPECIFICATION GUIDE FOR RELEVANT OCCUPANCY TYPES)

SCALE	SIZE	DRAWING NO
1:15	A4	FPA653501
REV.	DATE ISSUED	SHEET
A	2024-02-26	4

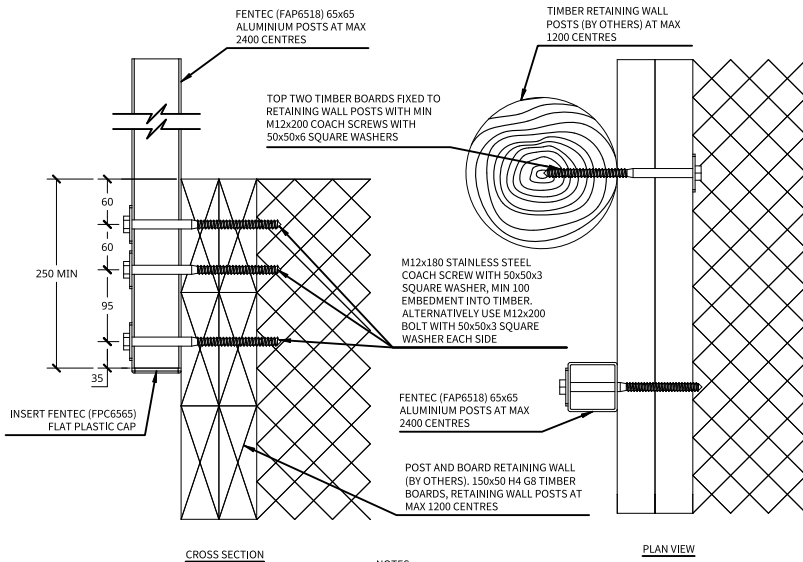


NOTES:
IF WALL IS SLOPING, PACK FENCE POSTS TO VERTICAL AND ADJUST COACH SCREW LENGTH TO SUIT, ALL INGROUND FIXINGS TO BE STAINLESS STEEL

DRAWING NO: SRB653524-B
APPLICATION: SIDE-FIX TO TIMBER RETAINING WALL - DOUBLE BOARD (POST ON OUTSIDE OF RETAINING WALL)
LOADING: 0.35kN/m AT MAX 2400 POST CENTRES

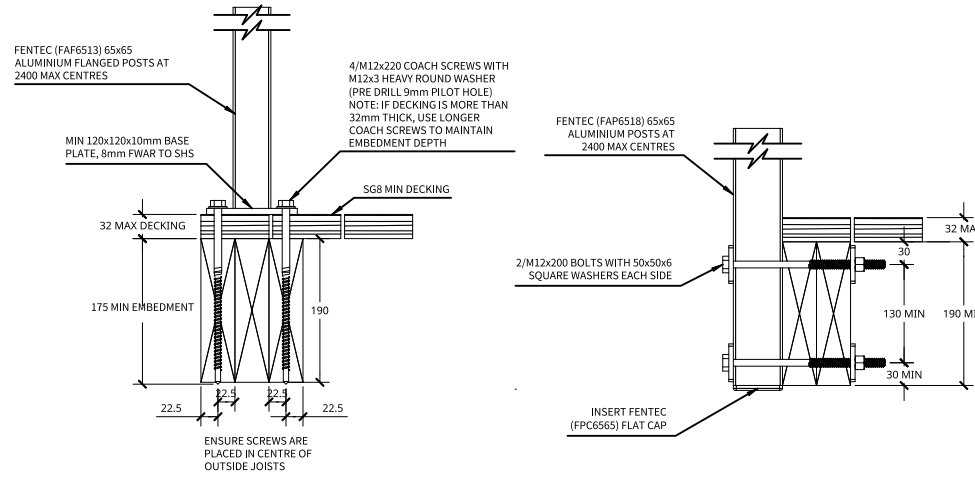


DRAWING NO: TTA653524
APPLICATION: TOP-FIX TO TIMBER DECK
LOADING: 0.35kN/m AT MAX 2400 POST CENTRES

DRAWING NO: STA653524
APPLICATION: SIDE-FIX TO TIMBER DECK
LOADING: 0.35kN/m AT MAX 2400 POST CENTRES

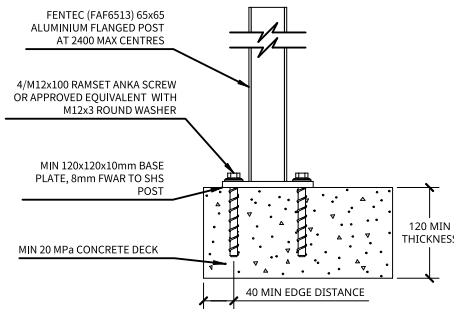

DRAWING NO: TDA653524
APPLICATION: TOP-FIX TO CONCRETE DECK
LOADING: 0.35kN/m AT MAX 2400 POST CENTRES

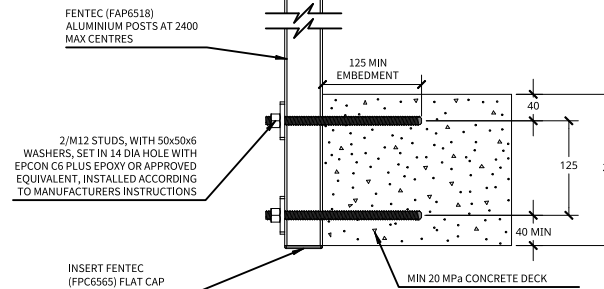

DRAWING NO: SDA653524-A
APPLICATION: SIDE-FIX TO CONCRETE DECK (205 min THICKNESS)
LOADING: 0.35kN/m AT MAX 2400 POST CENTRES

General Notes

- All dimensions are in millimetres.
- Drawings are not necessarily to scale
- Check www.fentec.co.nz to ensure you have the most recent edition of this publication.

Fixing Notes

- All coach screws and bolts to be pre-drilled according to NZS 3603:1997
- When fixing self-drilling screws, ensure low torque setting to avoid thread stripping. A battery drill is recommended for self-drilling screws - DO NOT use an impact driver.

Corrosion Zones

There are four corrosion zones in New Zealand that relate to the severity of exposure to wind-driven salt. See maps in figure 4.2 of NZS 3604:2011 (or online search 'BRANZ Maps') to determine the corrosion zone of the installation location and appropriate fixing option required.

Zone	Risk Level & Location	Fixing Type
Zone B	Low risk	Hot-dip Galvanised
Zone C	Medium risk	Hot-dip Galvanised
Zone D	High risk, all offshore islands, locations within 500m of coastline including harbours, locations within 100m of tidal estuaries and sheltered inlets.	316 Stainless Steel
Zone E	Very high risk, locations described in Zone D, beachfronts and seaside locations.	316 Stainless Steel

Existing Support Structure

- Supporting structures as not covered by these drawings unless specific requirements are detailed.
- Supporting structures are by others and must comply with the New Zealand Building Code.
- If unsure of existing structure compliance, seek professional advice.



Terranota Ltd. P.O. Box 1703 Invercargill 1703
Telephone: 0800 002 725
Email: sales@fentec.co.nz
Website: www.fentec.co.nz

©Copyright February 2024. All rights reserved to Terranota Ltd.


This document and the copyright in this document remain the property of TERRANOTA LTD. The contents of this document may not be reproduced either in whole or in part by any means whatsoever without the prior written consent of TERRANOTA LTD.

TITLE:
FENTEC BARRIER FIXING DESIGNS FOR:
- TIMBER RETAINING WALL (DOUBLE BOARD)
- TIMBER DECK
- CONCRETE DECK


FOR 0.35kN/m HORIZONTAL LOADING

(REFER TO BARRIER SPECIFICATION GUIDE FOR RELEVANT OCCUPANCY TYPES)


SCALE	SIZE	DRAWING NO
1:10	A4	DPA653502
REV.	DATE ISSUED	SHEET
A	2024-02-26	5

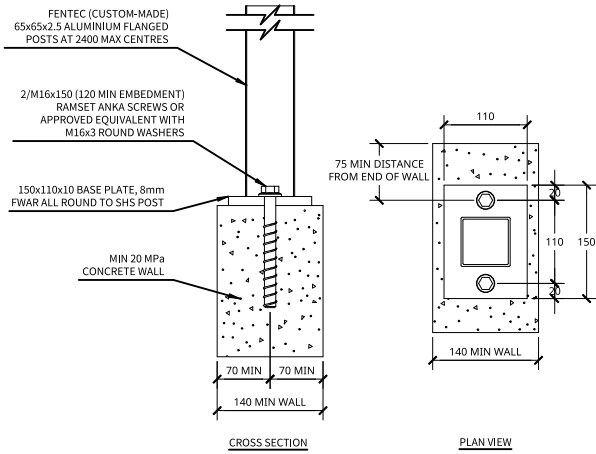


DRAWING NO: TWA653524-A
APPLICATION: TOP-FIX TO CONCRETE WALL
LOADING: 0.35kN/m AT MAX 2400 POST CENTRES

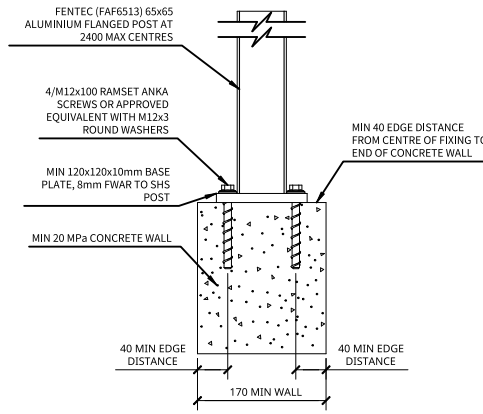


DRAWING NO: TWA653524-B
APPLICATION: TOP-FIX TO CONCRETE WALL
LOADING: 0.35kN/m AT MAX 2400 POST CENTRES

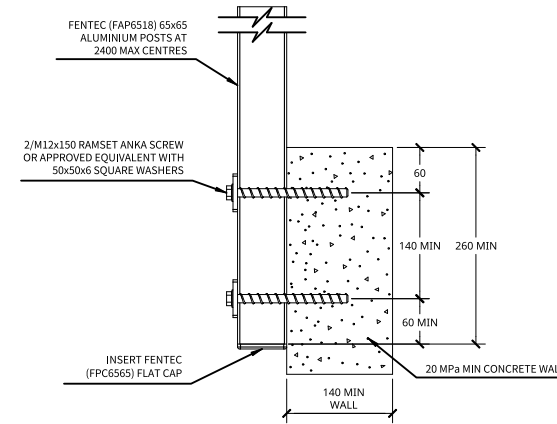


DRAWING NO: SWA653524
APPLICATION: SIDE-FIX TO CONCRETE WALL
LOADING: 0.35kN/m AT MAX 2400 POST CENTRES

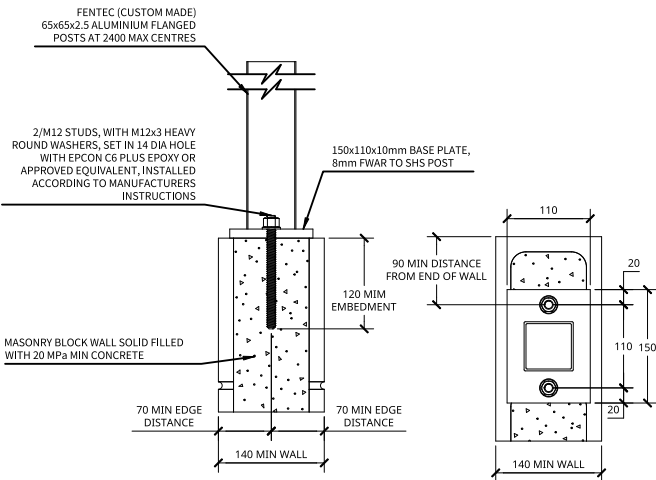

DRAWING NO: TMA653524-A
APPLICATION: TOP-FIX TO MASONRY WALL (15 SERIES)
LOADING: 0.35kN/m AT MAX 2400 POST CENTRES

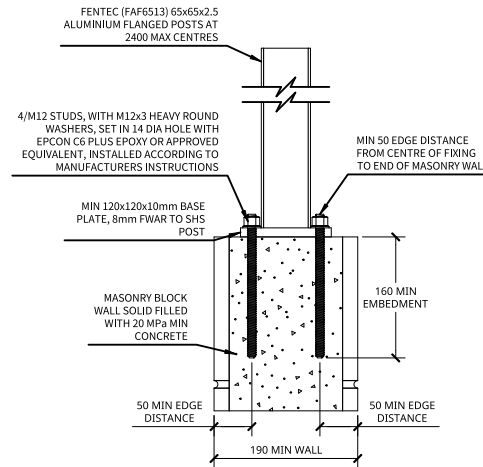

DRAWING NO: TMA653524-B
APPLICATION: TOP-FIX TO MASONRY WALL (20 SERIES)
LOADING: 0.35kN/m AT MAX 2400 POST CENTRES

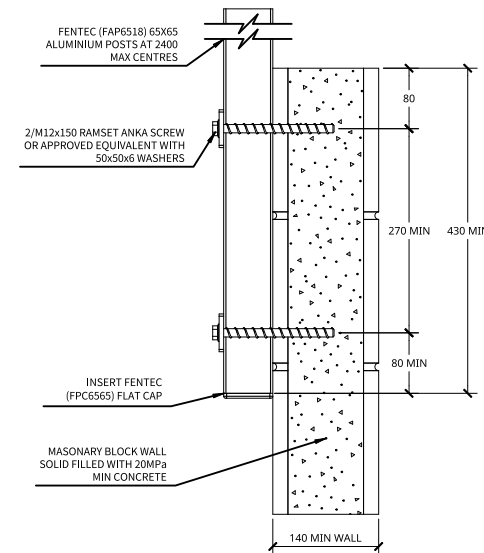

DRAWING NO: SMA653524
APPLICATION: SIDE-FIX TO MASONRY WALL (15 SERIES)
LOADING: 0.35kN/m AT MAX 2400 POST CENTRES

General Notes

- All dimensions are in millimetres.
- Drawings are not necessarily to scale
- Check www.fentec.co.nz to ensure you have the most recent edition of this publication.

Fixing Notes

- All coach screws and bolts to be pre-drilled according to NZS 3603:1997
- When fixing self-drilling screws, ensure low torque setting to avoid thread stripping. A battery drill is recommended for self-drilling screws - DO NOT use an impact driver.

Corrosion Zones

There are four corrosion zones in New Zealand that relate to the severity of exposure to wind-driven salt. See maps in figure 4.2 of NZS 3604:2011 (or online search 'BRANZ Maps') to determine the corrosion zone of the installation location and appropriate fixing option required.

Zone	Risk Level & Location	Fixing Type
Zone B	Low risk	Hot-dip Galvanised
Zone C	Medium risk	Hot-dip Galvanised
Zone D	High risk, all offshore islands, locations within 500m of coastline including harbours, locations within 100m of tidal estuaries and sheltered inlets.	316 Stainless Steel
Zone E	Very high risk, locations described in Zone D, beachfronts and seaside locations.	316 Stainless Steel

Existing Support Structure

- Supporting structures as not covered by these drawings unless specific requirements are detailed.
- Supporting structures are by others and must comply with the New Zealand Building Code.
- If unsure of existing structure compliance, seek professional advice.



Terranota Ltd. P.O. Box 1703 Invercargill 1703
Telephone: 0800 002 725
Email: sales@fentec.co.nz
Website: www.fentec.co.nz

©Copyright February 2024. All rights reserved to Terranota Ltd.


This document and the copyright in this document remain the property of TERRANOTA LTD. The contents of this document may not be reproduced either in whole or in part by any means whatsoever without the prior written consent of TERRANOTA LTD.

TITLE
FENTEC BARRIER FIXING DESIGNS FOR:
- CONCRETE WALL
- MASONRY WALL


FOR 0.35kN/m HORIZONTAL LOADING

(REFER TO BARRIER SPECIFICATION GUIDE FOR RELEVANT OCCUPANCY TYPES)


SCALE	SIZE	DRAWING NO
1:10	A4	DPA653503
REV.	DATE ISSUED	SHEET
A	2024-02-26	6

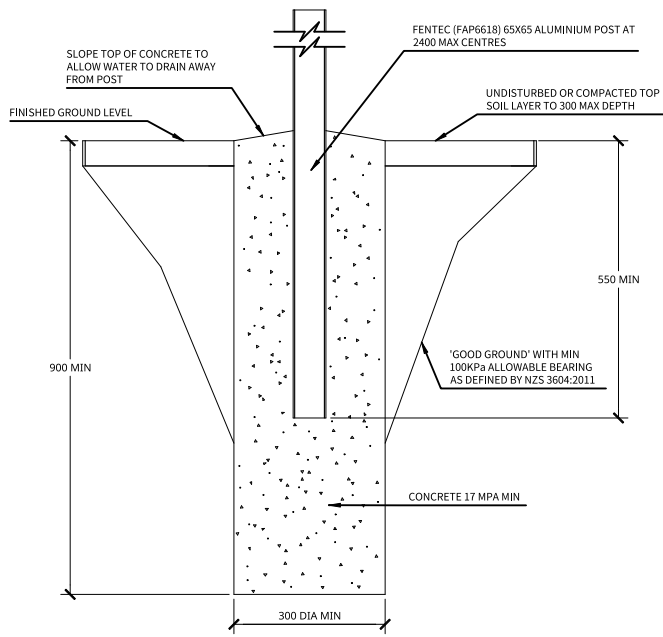


DRAWING NO: ICA667524
 APPLICATION: CONCRETE IN-GROUND
 LOADING: 0.75kN/m AT MAX 2400 POST CENTRES

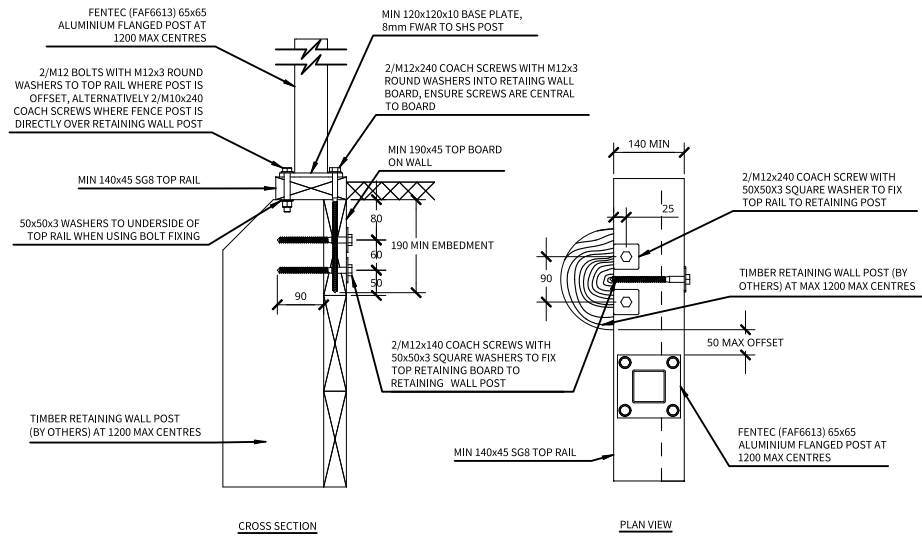

DRAWING NO: TRA657512
 APPLICATION: TOP-FIX TO TIMBER RETAINING WALL
 LOADING: 0.75kN/m AT MAX 1260 POST CENTRES
 (NOTE: 0.75kN/m AT MAX 2400 POST CENTRE
 SUBJECT TO SPECIFIC ENGINEERING DESIGN)

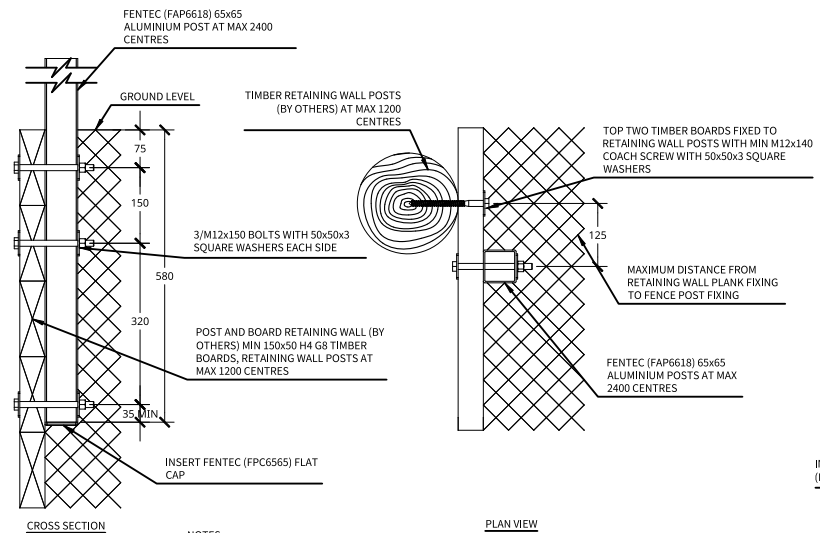

DRAWING NO: SRA667524-A
 APPLICATION: SIDE-FIX TO TIMBER RETAINING WALL (POST ON INSIDE OF RETAINING WALL)
 LOADING: 0.75kN/m AT MAX 2400 POST CENTRES

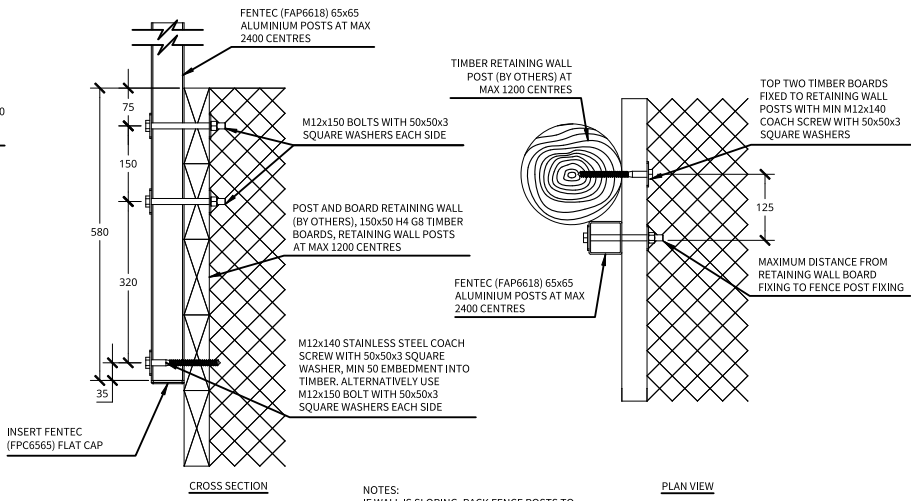

DRAWING NO: SRA667524-B
 APPLICATION: SIDE-FIX TO TIMBER RETAINING WALL (POST ON OUTSIDE OF RETAINING WALL)
 LOADING: 0.75kN/m AT MAX 2400 POST CENTRES

- General Notes**
- All dimensions are in millimetres.
 - Drawings are not necessarily to scale
 - Check www.fentec.co.nz to ensure you have the most recent edition of this publication.

- Fixing Notes**
- All coach screws and bolts to be pre-drilled according to NZS 3603:1997
 - When fixing self-drilling screws, ensure low torque setting to avoid thread stripping. A battery drill is recommended for self-drilling screws - DO NOT use an impact driver.

Corrosion Zones

There are four corrosion zones in New Zealand that relate to the severity of exposure to wind-driven salt. See maps in figure 4.2 of NZS 3604:2011 (or online search 'BRANZ Maps') to determine the corrosion zone of the installation location and appropriate fixing option required.

Zone	Risk Level & Location	Fixing Type
Zone B	Low risk	Hot-dip Galvanised
Zone C	Medium risk	Hot-dip Galvanised
Zone D	High risk, all offshore islands, locations within 500m of coastline including harbours, locations within 100m of tidal estuaries and sheltered inlets.	316 Stainless Steel
Zone E	Very high risk, locations described in Zone D, beachfronts and seaside locations.	316 Stainless Steel

Existing Support Structure

1. Supporting structures as not covered by these drawings unless specific requirements are detailed.

2. Supporting structures are by others and must comply with the New Zealand Building Code.

3. If unsure of existing structure compliance, seek professional advice.



Terranota Ltd. P.O. Box 1703 Invercargill 1703
 Telephone: 0800 002 725
 Email: sales@fentec.co.nz
 Website: www.fentec.co.nz


©Copyright February 2024. All rights reserved to Terranota Ltd.

This document and the copyright in this document remain the property of TERRANOTA LTD. The contents of this document may not be reproduced either in whole or in part by any means whatsoever without the prior written consent of TERRANOTA LTD.

TITLE
 FENTEC BARRIER FIXING DESIGNS
 FOR:
 - CONCRETE IN-GROUND
 - TIMBER RETAINING WALL

FOR 0.75kN/m HORIZONTAL
 LOADING
 (REFER TO BARRIER SPECIFICATION GUIDE FOR RELEVANT OCCUPANCY TYPES)

SCALE	SIZE	DRAWING NO
1:15	A4	FPA667501
REV.	DATE ISSUED	SHEET
A	2024-02-26	7

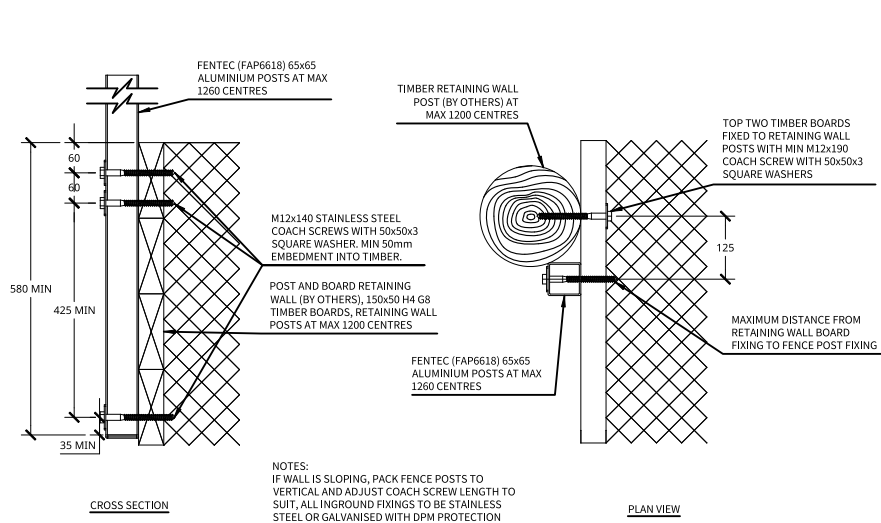


NOTES:
IF WALL IS SLOPING, PACK FENCE POSTS TO VERTICAL AND ADJUST COACH SCREW LENGTH TO SUIT, ALL INGROUND FIXINGS TO BE STAINLESS STEEL OR GALVANISED WITH DPM PROTECTION

CROSS SECTION

PLAN VIEW

DRAWING NO: SRB657512-A
APPLICATION: SIDE-FIX TO SINGLE BOARD TIMBER RETAINING WALL (POSTS ON OUTSIDE OF RETAINING WALL)
LOADING: 0.75kN/m AT MAX 1260 POST CENTRES
(NOTE: 0.75kN/m AT MAX 2400 POST CENTRE SUBJECT TO SPECIFIC ENGINEERING DESIGN)

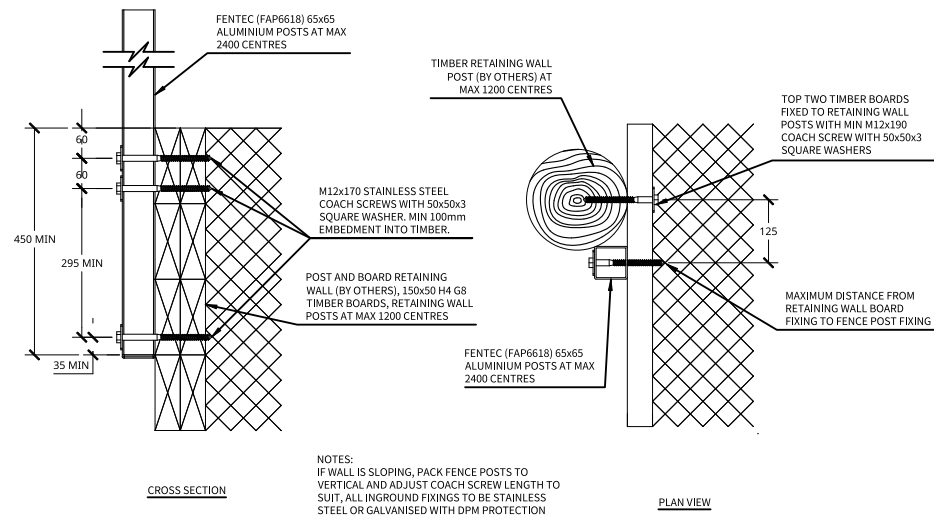

NOTES:
IF WALL IS SLOPING, PACK FENCE POSTS TO VERTICAL AND ADJUST COACH SCREW LENGTH TO SUIT, ALL INGROUND FIXINGS TO BE STAINLESS STEEL OR GALVANISED WITH DPM PROTECTION

CROSS SECTION

PLAN VIEW

DRAWING NO: SRB667524-B
APPLICATION: SIDE-FIX TO DOUBLE BOARD TIMBER RETAINING WALL (POSTS ON OUTSIDE OF RETAINING WALL)
LOADING: 0.75kN/m AT MAX 2400 POST CENTRES

General Notes

- All dimensions are in millimetres.
- Drawings are not necessarily to scale
- Check www.fentec.co.nz to ensure you have the most recent edition of this publication.

Fixing Notes

- All coach screws and bolts to be pre-drilled according to NZS 3603:1997
- When fixing self-drilling screws, ensure low torque setting to avoid thread stripping. A battery drill is recommended for self-drilling screws - DO NOT use an impact driver.

Corrosion Zones

There are four corrosion zones in New Zealand that relate to the severity of exposure to wind-driven salt. See maps in figure 4.2 of NZS 3604:2011 (or online search 'BRANZ Maps') to determine the corrosion zone of the installation location and appropriate fixing option required.

Zone	Risk Level & Location	Fixing Type
Zone B	Low risk	Hot-dip Galvanised
Zone C	Medium risk	Hot-dip Galvanised
Zone D	High risk, all offshore islands, locations within 500m of coastline including harbours, locations within 100m of tidal estuaries and sheltered inlets.	316 Stainless Steel
Zone E	Very high risk, locations described in Zone D, beachfronts and seaside locations.	316 Stainless Steel

Existing Support Structure

- Supporting structures as not covered by these drawings unless specific requirements are detailed.
- Supporting structures are by others and must comply with the New Zealand Building Code.
- If unsure of existing structure compliance, seek professional advice.




Terranota Ltd. P.O. Box 1703 Invercargill 1703
Telephone: 0800 002 725
Email: sales@fentec.co.nz
Website: www.fentec.co.nz

©Copyright February 2024. All rights reserved to Terranota Ltd.


This document and the copyright in this document remain the property of TERRANOTA LTD. The contents of this document may not be reproduced either in whole or in part by any means whatsoever without the prior written consent of TERRANOTA LTD.

TITLE
FENTEC BARRIER FIXING DESIGNS FOR:
- TIMBER RETAINING WALL (Single and Double Board)
FOR 0.75kN/m HORIZONTAL LOADING
(REFER TO BARRIER SPECIFICATION GUIDE FOR RELEVANT OCUPANCY TYPES)


SCALE	SIZE	DRAWING NO
1:15	A4	FPA667502
REV.	DATE ISSUED	SHEET
A	2024-02-26	8

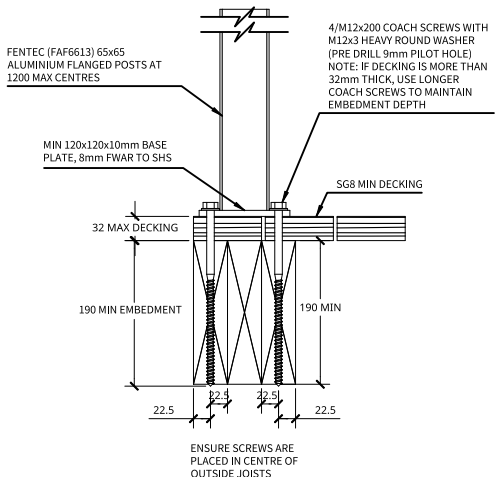


DRAWING NO: TTA657512
 APPLICATION: TOP-FIX TO TIMBER DECK
 LOADING: 0.75kN/m, AT MAX 1260 POST CENTRES
 (NOTE: 0.75kN/m AT MAX 2400 POST CENTRE
 SUBJECT TO SPECIFIC ENGINEERING DESIGN
 INCLUDING SUPPORTING STRUCTURE)

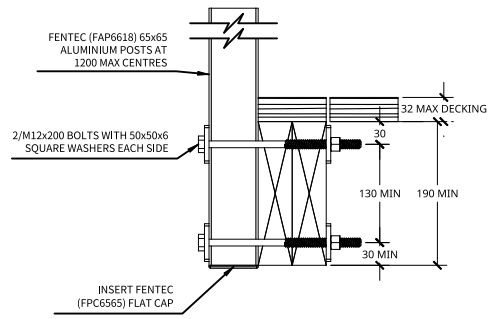


DRAWING NO: STA657512
 APPLICATION: SIDE-FIX TO TIMBER DECK
 LOADING: 0.75kN/m, AT MAX 1200 POST CENTRES
 (NOTE: 0.75kN/m AT MAX 2400 POST CENTRE
 SUBJECT TO SPECIFIC ENGINEERING DESIGN OF
 SUPPORTING STRUCTURE)

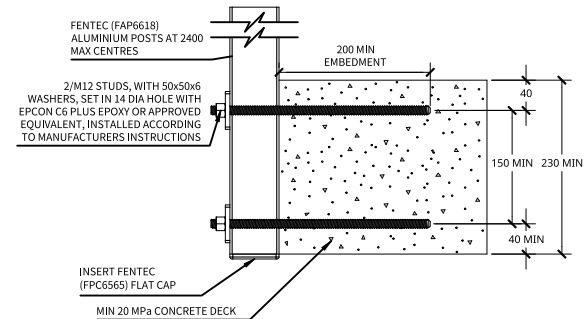


DRAWING NO: SDA667524-A
 APPLICATION: SIDE-FIX TO CONCRETE DECK (230 MIN THICKNESS)
 LOADING: 0.75kN/m, AT MAX 2400 POST CENTRES

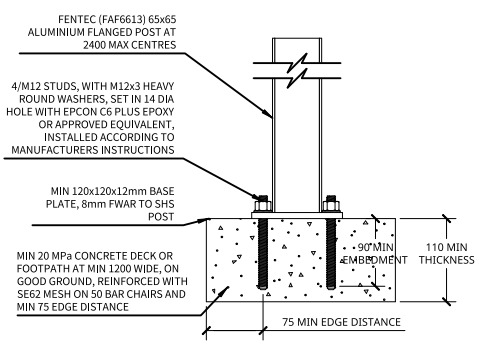


DRAWING NO: TDA667524-A
 APPLICATION: TOP-FIX TO CONCRETE PATH OR DECK
 (MIN 1.2m WIDE)
 LOADING: 0.75kN/m AT MAX 2400 POST CENTRES

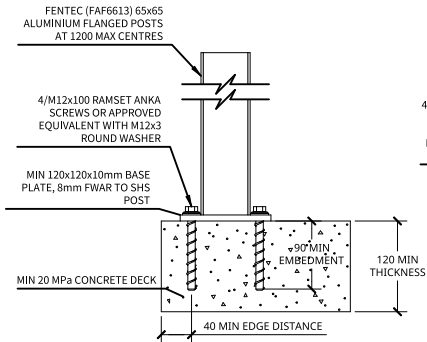

DRAWING NO: TDA657512
 APPLICATION: TOP-FIX TO CONCRETE DECK
 LOADING: 0.75kN/m AT MAX 1270 POST CENTRES

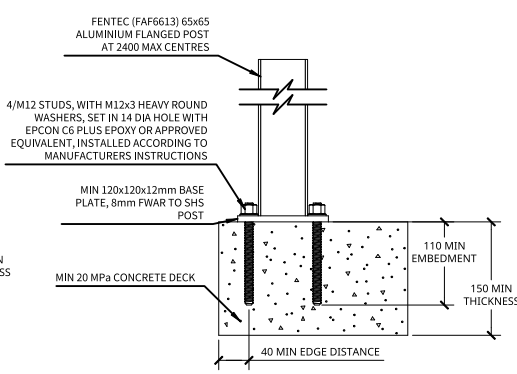

DRAWING NO: TDA667524-B
 APPLICATION: TOP-FIX TO CONCRETE DECK
 LOADING: 0.75kN/m AT MAX 2400 POST CENTRES

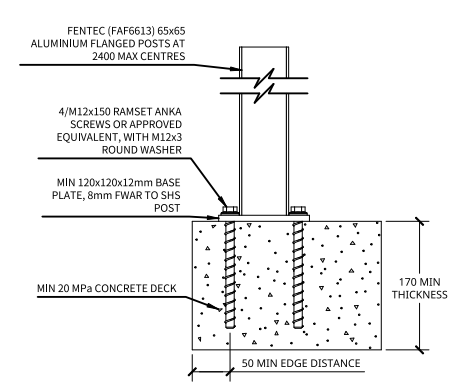

DRAWING NO: TDA667524-C
 APPLICATION: TOP-FIX TO CONCRETE DECK
 LOADING: 0.75kN/m AT MAX 2400 POST CENTRES

- General Notes**
- All dimensions are in millimetres.
 - Drawings are not necessarily to scale
 - Check www.fentec.co.nz to ensure you have the most recent edition of this publication.

- Fixing Notes**
- All coach screws and bolts to be pre-drilled according to NZS 3603:1997
 - When fixing self-drilling screws, ensure low torque setting to avoid thread stripping. A battery drill is recommended for self-drilling screws - DO NOT use an impact driver.

Corrosion Zones

There are four corrosion zones in New Zealand that relate to the severity of exposure to wind-driven salt. See maps in figure 4.2 of NZS 3604:2011 (or online search 'BRANZ Maps') to determine the corrosion zone of the installation location and appropriate fixing option required.

Zone	Risk Level & Location	Fixing Type
Zone B	Low risk	Hot-dip Galvanised
Zone C	Medium risk	Hot-dip Galvanised
Zone D	High risk, all offshore islands, locations within 500m of coastline including harbours, locations within 100m of tidal estuaries and sheltered inlets.	316 Stainless Steel
Zone E	Very high risk, locations described in Zone D, beachfronts and seaside locations.	316 Stainless Steel

- Existing Support Structure**
- Supporting structures as not covered by these drawings unless specific requirements are detailed.
 - Supporting structures are by others and must comply with the New Zealand Building Code.
 - If unsure of existing structure compliance, seek professional advice.




Terranota Ltd. P.O. Box 1703 Invercargill 1703
 Telephone: 0800 002 725
 Email: sales@fentec.co.nz
 Website: www.fentec.co.nz

©Copyright February 2024. All rights reserved to Terranota Ltd.


This document and the copyright in this document remain the property of TERRANOTA LTD. The contents of this document may not be reproduced either in whole or in part by any means whatsoever without the prior written consent of TERRANOTA LTD.

TITLE:
FENTEC BARRIER FIXING DESIGNS
 FOR:
 - TIMBER DECK
 - CONCRETE DECK
 FOR 0.75kN/m HORIZONTAL
 LOADING
 (REFER TO BARRIER SPECIFICATION GUIDE FOR
 RELEVANT OCCUPANCY TYPES)


SCALE	SIZE	DRAWING NO
1:10	A4	FPA667503
REV.	DATE ISSUED	SHEET
A	2024-02-26	9

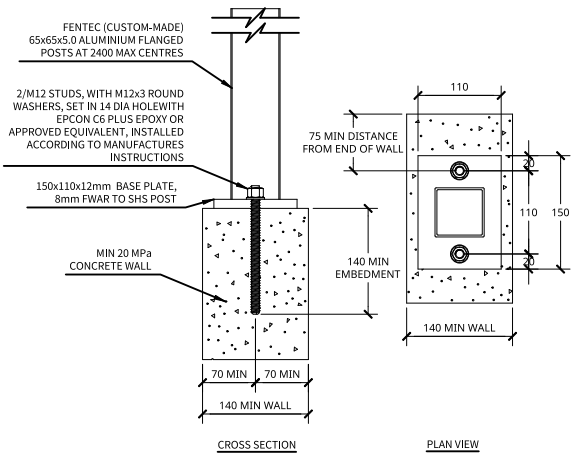


DRAWING NO: TWA667524-A
APPLICATION: TOP-FIX TO CONCRETE WALL
LOADING: 0.75kN/m AT MAX 1260 POST CENTRE

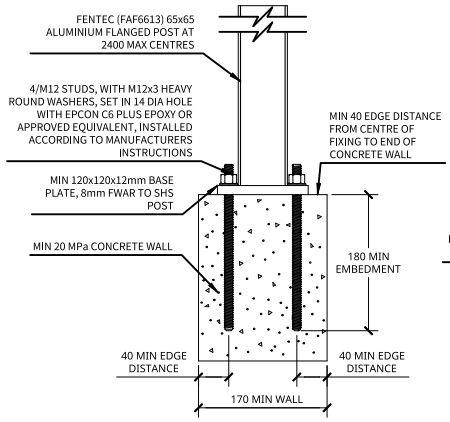


DRAWING NO: TWA667524-B
APPLICATION: TOP-FIX TO CONCRETE WALL
LOADING: 0.75kN/m, AT MAX 2400 POST CENTRE

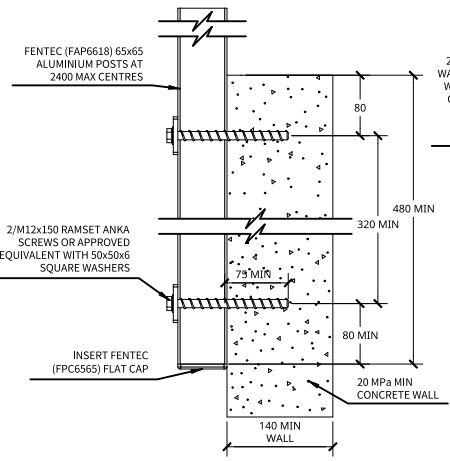


DRAWING NO: SWA667524-A
APPLICATION: SIDE-FIX TO CONCRETE WALL
LOADING: 0.75kN/m, AT MAX 2400 POST CENTRE

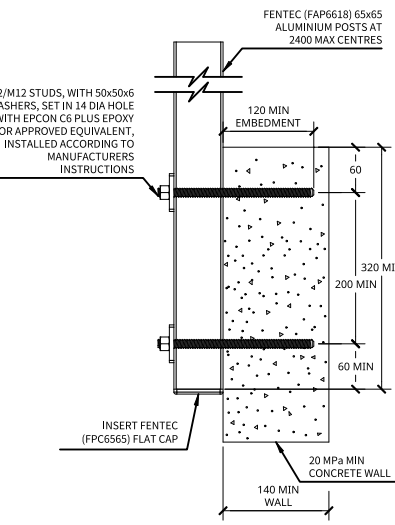


DRAWING NO: SWA667524-B
APPLICATION: SIDE-FIX TO CONCRETE WALL
LOADING: 0.75kN/m, AT MAX 2400 POST CENTRE

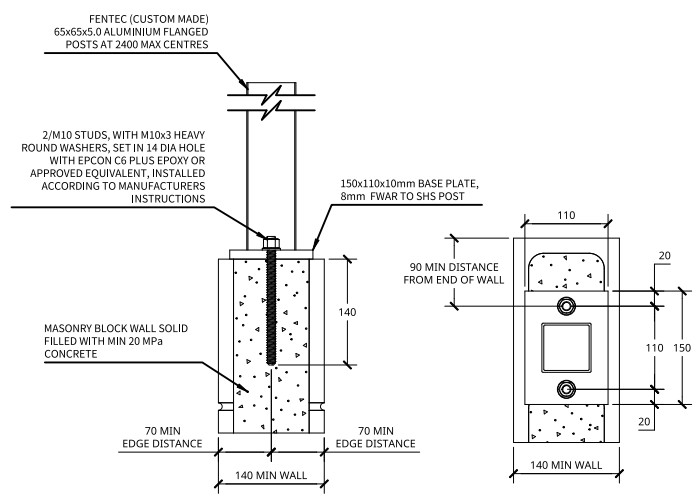

DRAWING NO: TMA67512
APPLICATION: TOP-FIX TO MASONRY WALL
LOADING: 0.75kN/m, AT MAX 1200 POST CENTRE (NOTE: 0.75kN/m AT MAX 2400 POST CENTRE NOT POSSIBLE TO TOP-FIX ON 15 SERIES MASONRY WALL)

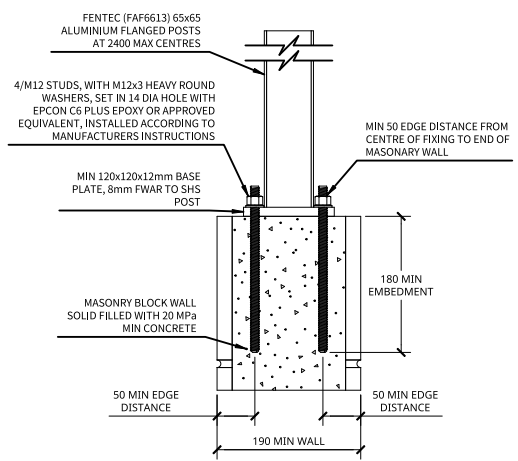

DRAWING NO: TMA667524
APPLICATION: TOP-FIX TO MASONRY WALL
LOADING: 0.75kN/m AT MAX 2400 POST CENTRE

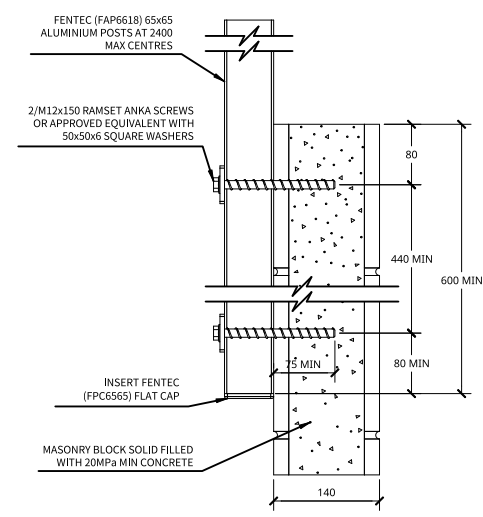

DRAWING NO: SMA667524
APPLICATION: SIDE-FIX TO MASONRY WALL (15 SERIES)
LOADING: 0.75kN/m AT MAX 2400 POST CENTRE

General Notes
1. All dimensions are in millimetres.
2. Drawings are not necessarily to scale
3. Check www.fentec.co.nz to ensure you have the most recent edition of this publication.

Fixing Notes
1. All coach screws and bolts to be pre-drilled according to NZS 3603:1997
2. When fixing self-drilling screws, ensure low torque setting to avoid thread stripping. A battery drill is recommended for self-drilling screws - DO NOT use an impact driver.

Corrosion Zones
There are four corrosion zones in New Zealand that relate to the severity of exposure to wind-driven salt. See maps in figure 4.2 of NZS 3604:2011 (or online search 'BRANZ Maps') to determine the corrosion zone of the installation location and appropriate fixing option required.

Zone	Risk Level & Location	Fixing Type
Zone B	Low risk	Hot-dip Galvanised
Zone C	Medium risk	Hot-dip Galvanised
Zone D	High risk, all offshore islands, locations within 500m of coastline including harbours, locations within 100m of tidal estuaries and sheltered inlets.	316 Stainless Steel
Zone E	Very high risk, locations described in Zone D, beachfronts and seaside locations.	316 Stainless Steel

Existing Support Structure
1. Supporting structures as not covered by these drawings unless specific requirements are detailed.
2. Supporting structures are by others and must comply with the New Zealand Building Code.
3. If unsure of existing structure compliance, seek professional advice.

Terranota Ltd. P.O. Box 1703 Invercargill 1703
Telephone: 0800 002 725
Email: sales@fentec.co.nz
Website: www.fentec.co.nz
©Copyright February 2024. All rights reserved to Terranota Ltd.

This document and the copyright in this document remain the property of TERRANOTA LTD. The contents of this document may not be reproduced either in whole or in part by any means whatsoever without the prior written consent of TERRANOTA LTD.

TITLE:
FENTEC BARRIER FIXING DESIGNS
FOR:
- CONCRETE WALL
- MASONRY WALL
FOR 0.75kN/m
HORIZONTAL LOADING
(REFER TO BARRIER SPECIFICATION GUIDE FOR RELEVANT OCCUPANCY TYPES)

SCALE	SIZE	DRAWING NO
1:10	A4	FPA667504
REV.	DATE ISSUED	SHEET
A	2024-02-26	10



PRODUCER STATEMENT – PS1 DESIGN

BUILDING CODE CLAUSE(S): [] | **JOB NUMBER:** []

ISSUED BY: []

(Engineering Design Firm)

TO: []

(Owner/Developer)

TO BE SUPPLIED TO: []

(Building Consent Authority)

IN RESPECT OF: []

(Description of Building Work)

AT: []

(Address, Town/City)

LEGAL DESCRIPTION: [] | **N/A**

We have been engaged by the owner/developer referred to above to provide *(Extent of Engagement):* []

in respect of the requirements of the Clause(s) of the Building Code specified above for Choose an item., as specified in the Schedule, of the proposed building work.

The design carried out by us has been prepared in accordance with:

- Compliance documents issued by the Ministry of Business, Innovation & Employment *(Verification method/acceptable solution)* [] and/or;
- Alternative solution as per the attached Schedule.

The proposed building work covered by this producer statement is described on the drawings specified in the Schedule, together with the specification, and other documents set out in the Schedule.

On behalf of the Engineering Design Firm, and subject to:

- Site verification of the following design assumptions: []
- All proprietary products meeting their performance specification requirements;

I believe on reasonable grounds that:

- the building, if constructed in accordance with the drawings, specifications, and other documents provided or listed in the Schedule, will comply with the relevant provisions of the Building Code and that;
- the persons who have undertaken the design have the necessary competency to do so.

I recommend following level of construction monitoring: B.C.A. Inspections and a PS3 from the approved installer.

I, *(Name of Engineering Design Professional)* [] , am:

- CPEng number []
- and hold the following qualifications

The Engineering Design Firm holds a current policy of Professional Indemnity Insurance no less than \$200,000
The Engineering Design Firm Choose one a member of ACE New Zealand.

SIGNED BY *(Name of Engineering Design Professional):*
(Signature below):

ON BEHALF OF *(Engineering Design Firm):*

Date: 22/03/25 EXP 21/03/26

Note: This statement has been prepared solely for the Building Consent Authority named above and shall not be relied upon by any other person or entity. Any liability in relation to this statement accrues to the Engineering Design Firm only. As a condition of reliance on this statement, the Building Consent Authority accepts that the total maximum amount of liability of any kind arising from this statement and all other statements provided to the Building Consent Authority in relation to this building work, whether in tort or otherwise, is limited to the sum of \$200,000.

This form is to accompany **Form 2 of the Building (Forms) Regulations 2004** for the application of a Building Consent.

SCHEDULE to PS1

Please include an itemised list of all referenced documents, drawings, or other supporting materials in relation to this producer statement below:



WWW.FENTEC.CO.NZ | 0800 002 725